




TRUST BLOCK AREA (Y&W)			
	90° BEND	45° BEND	22 1/2° BEND
t.	4 sq.ft.	2 sq.ft.	2 sq.ft.
t.	3 sq.ft.	2 sq.ft.	2 sq.ft.
t.	7 sq.ft.	4 sq.ft.	2 sq.ft.
t.	11 sq.ft.	6 sq.ft.	3 sq.ft.

SED ON 200 PSI TEST PRESSURE AND 2,000 L.B./SQ.FT.
 ER SOIL BEARING CAPACITIES ARE FOUND OR HIGHER
 QUIRED, AREA SHALL BE INCREASED ACCORDINGLY.
 SS SHALL BE POURED AGAINST UNDISTURBED SOIL.

oop

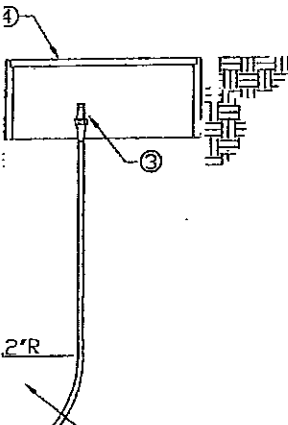

LANDS OF HORTON
 REC. ON 21 SEP. 1995
 BOOK 316, PAGE 018
 TRACT C-1-R-1

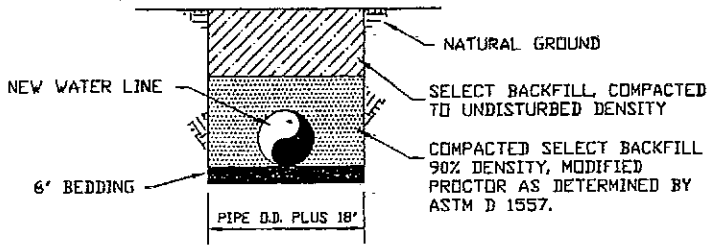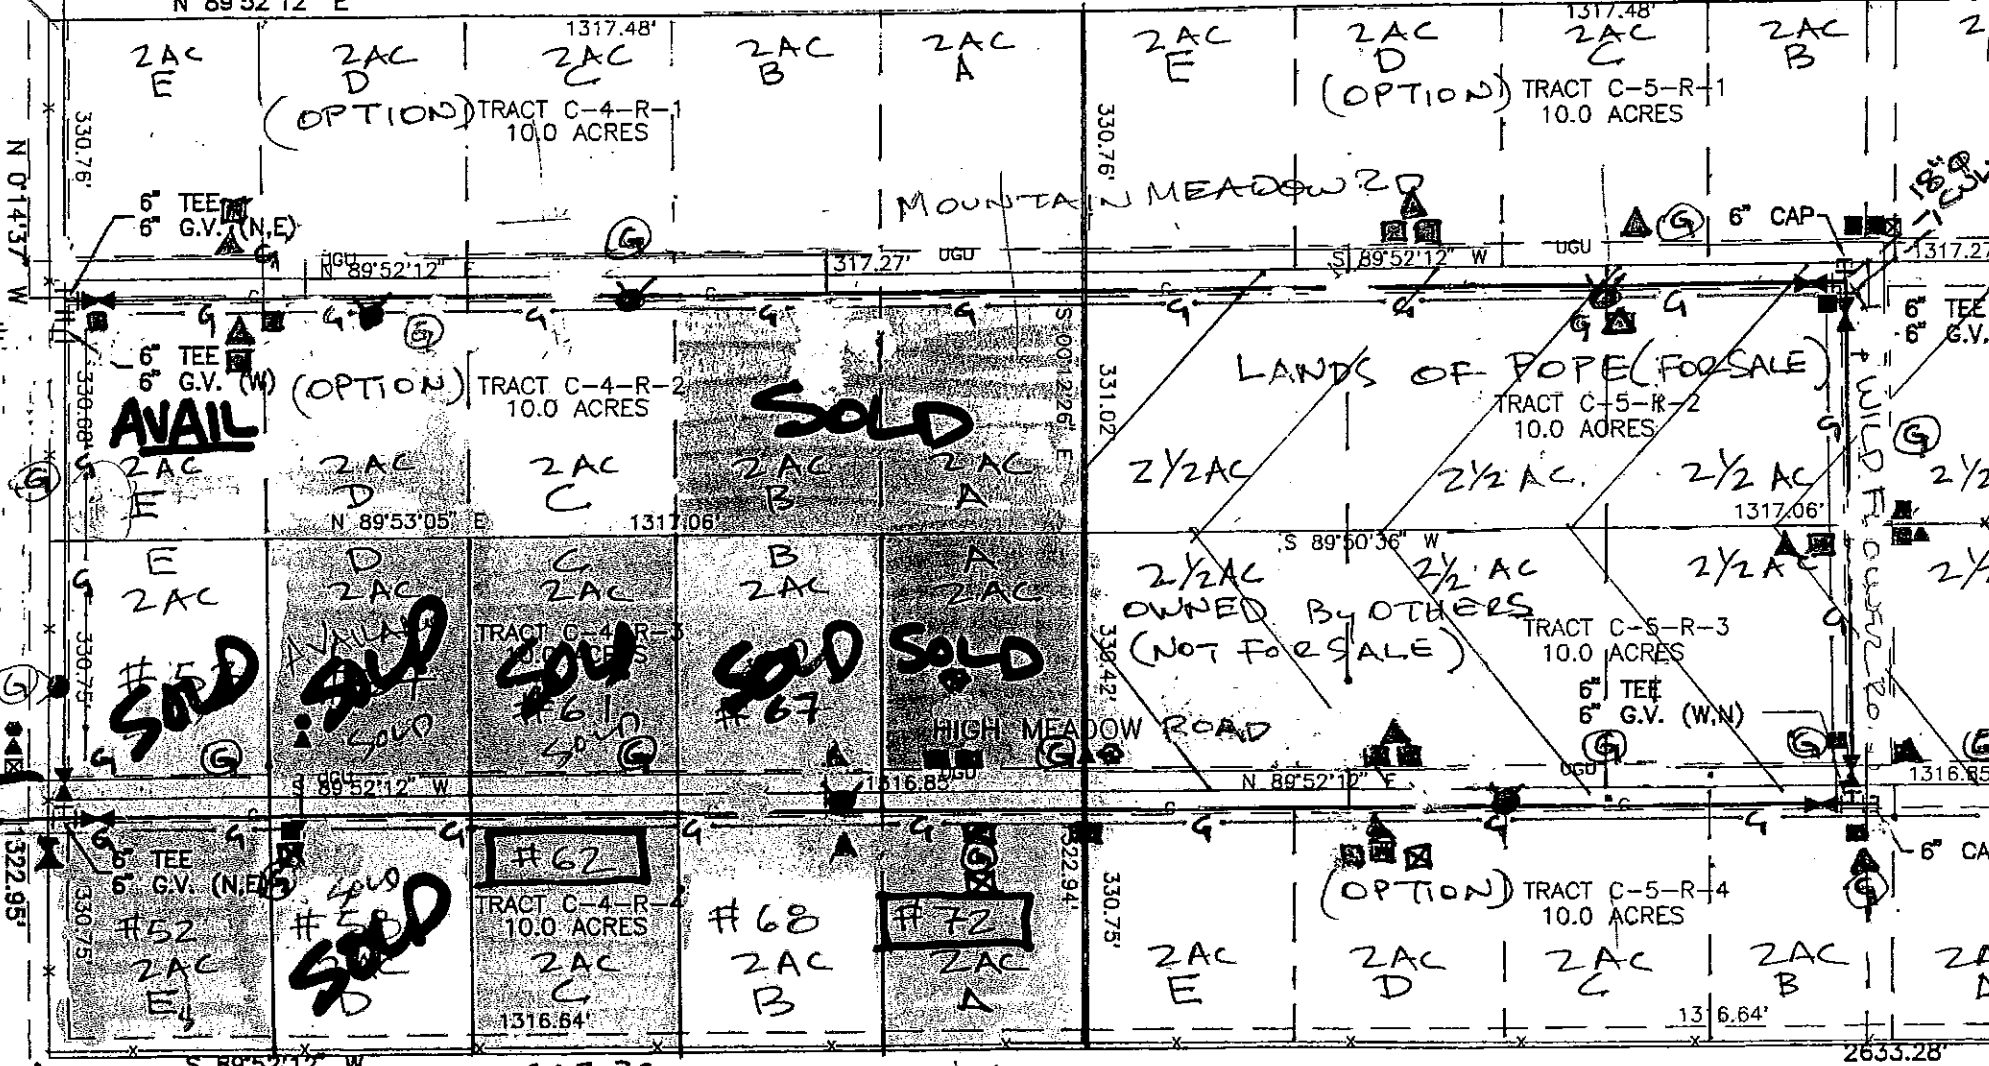

MATERIAL SPECIFICATIONS:

PIPE	6" P.V.C.
FIRE HYDRANTS	K-81 KENNEDY
GATE VALVES	WATERLOO SERIES 500
6" FITTINGS (TEE)	DUCTILE IRON-MJ
6" RESTRAINERS	BY MEGALUG

SERVICE CONNECTIONS:

6"X1" SADDLE	FORD S71
CORP STOPS	FORD F700
1" SERVICE LINE	POLY-PIPE SKR-7
TANDUM COPPER SETTERS	FORD
3/4" PRESSURE REDUCING VALVE	WILRENS #600
METER CAN W/C.I. LTD.	POLY LOCK