DHEC
PROMOTE PROTECT PROSPER

PERMIT TO CONSTRUCT - CERTIFICATE OF FINAL APPROVAL
Onsite Sewage Treatment and Disposal System

Permit No.: 2005-09-0009 Type Facility: 3 BR House TMS#: 0025.00.005.07

Name: Michael Perez Address: 112 Broadbill Dr. Mooresville, NC 28117 Sys. Category: 360/380

Subdivision: — Street: Steele Hill Rd. Section/Lot: 2 Type Water Supply: PW

SYSTEM SPECIFICATIONS

Max. Est. Daily Flow: 360 GPD
Loading Rate: .4
Tank Size(s): 1,000 GALLON

Trenches: Length: 210'
Width: 36"
Max. Bottom Depth: 48"
Aggregate Depth: 28"
Min. Pump Capacity: N/A gpm
at N/A ft. of Head

SPECIAL INSTRUCTIONS/CONDITIONS

*DRAWING NOT TO SCALE
*NO DRIVING/PARKING OR UTILITIES OVER/THRU THE ABSORPTION AREA.

PERMIT TO CONSTRUCT (NTS)

20.013 ACRES

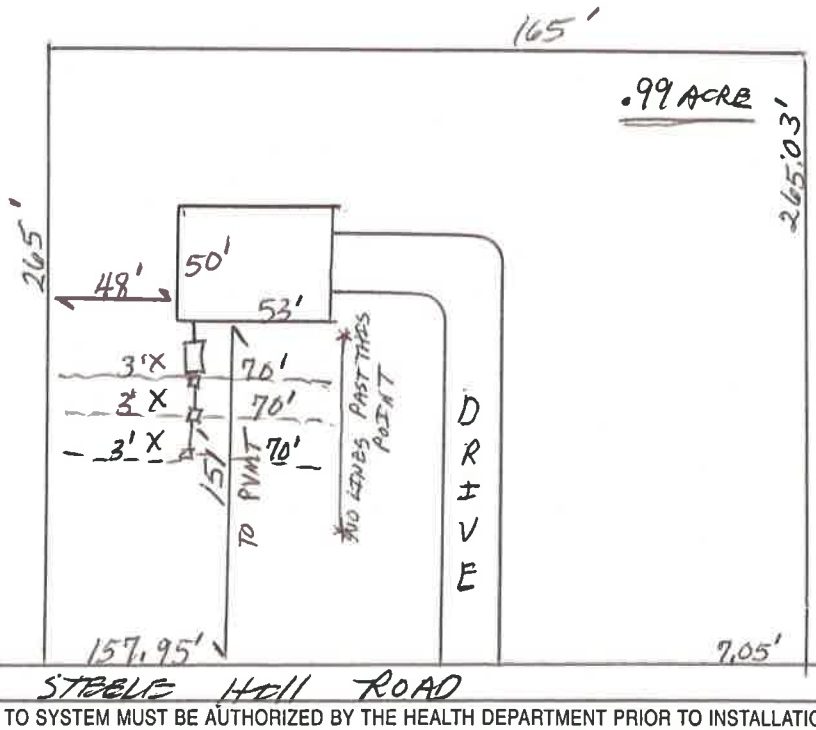

ANY CHANGES TO SYSTEM MUST BE AUTHORIZED BY THE HEALTH DEPARTMENT PRIOR TO INSTALLATION.

ACTUAL INSTALLATION

Installer: ROBERT VICKERY
Tank(s) Mfg.: J&S
Aggregate Type: STONE
Well Installed: Yes No
Nearest Actual Distance to:
Well: PUBLIC
Building: 6' 11"
Property Line: 5'
Stream/Impoundment: N/A

Line No.	Elevation Readings	
Stubout:	2'5"	
S/T Inlet:	4'5"	
S/T Outlet:	4'9"	
1	5'5"	5'5"
2	5'6"	5'6½"
3	5'6"	5'7"
4	5'11"	5'11" 6'
5	5'11"	6' 6'
6	6'1"	6'2"
7	6'1"	6'2"

CERTIFICATE OF FINAL APPROVAL (NST)

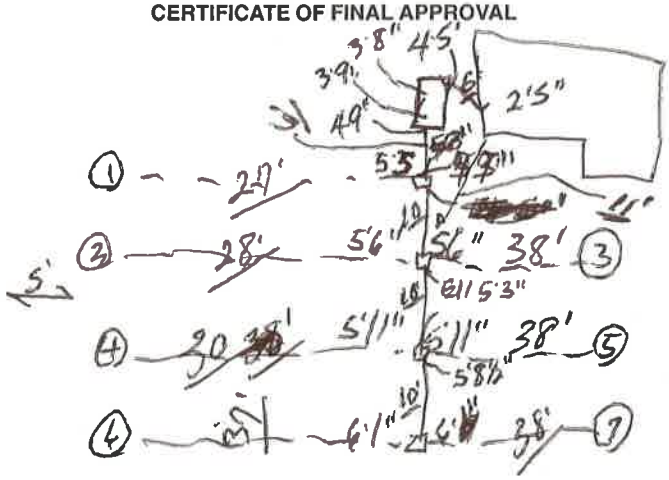

THIS CERTIFICATE OF FINAL APPROVAL IN NO WAY GUARANTEES THE LIFE OF THE SYSTEM OR THAT IT WILL FUNCTION PROPERLY UNDER ANY OR ALL CONDITIONS.

Issued By: Larry W. Estridge Date: 9-20-05 Approved By: Larry W. Estridge Date: 6-21-06

DHEC 1739 (12/2001)

FILE