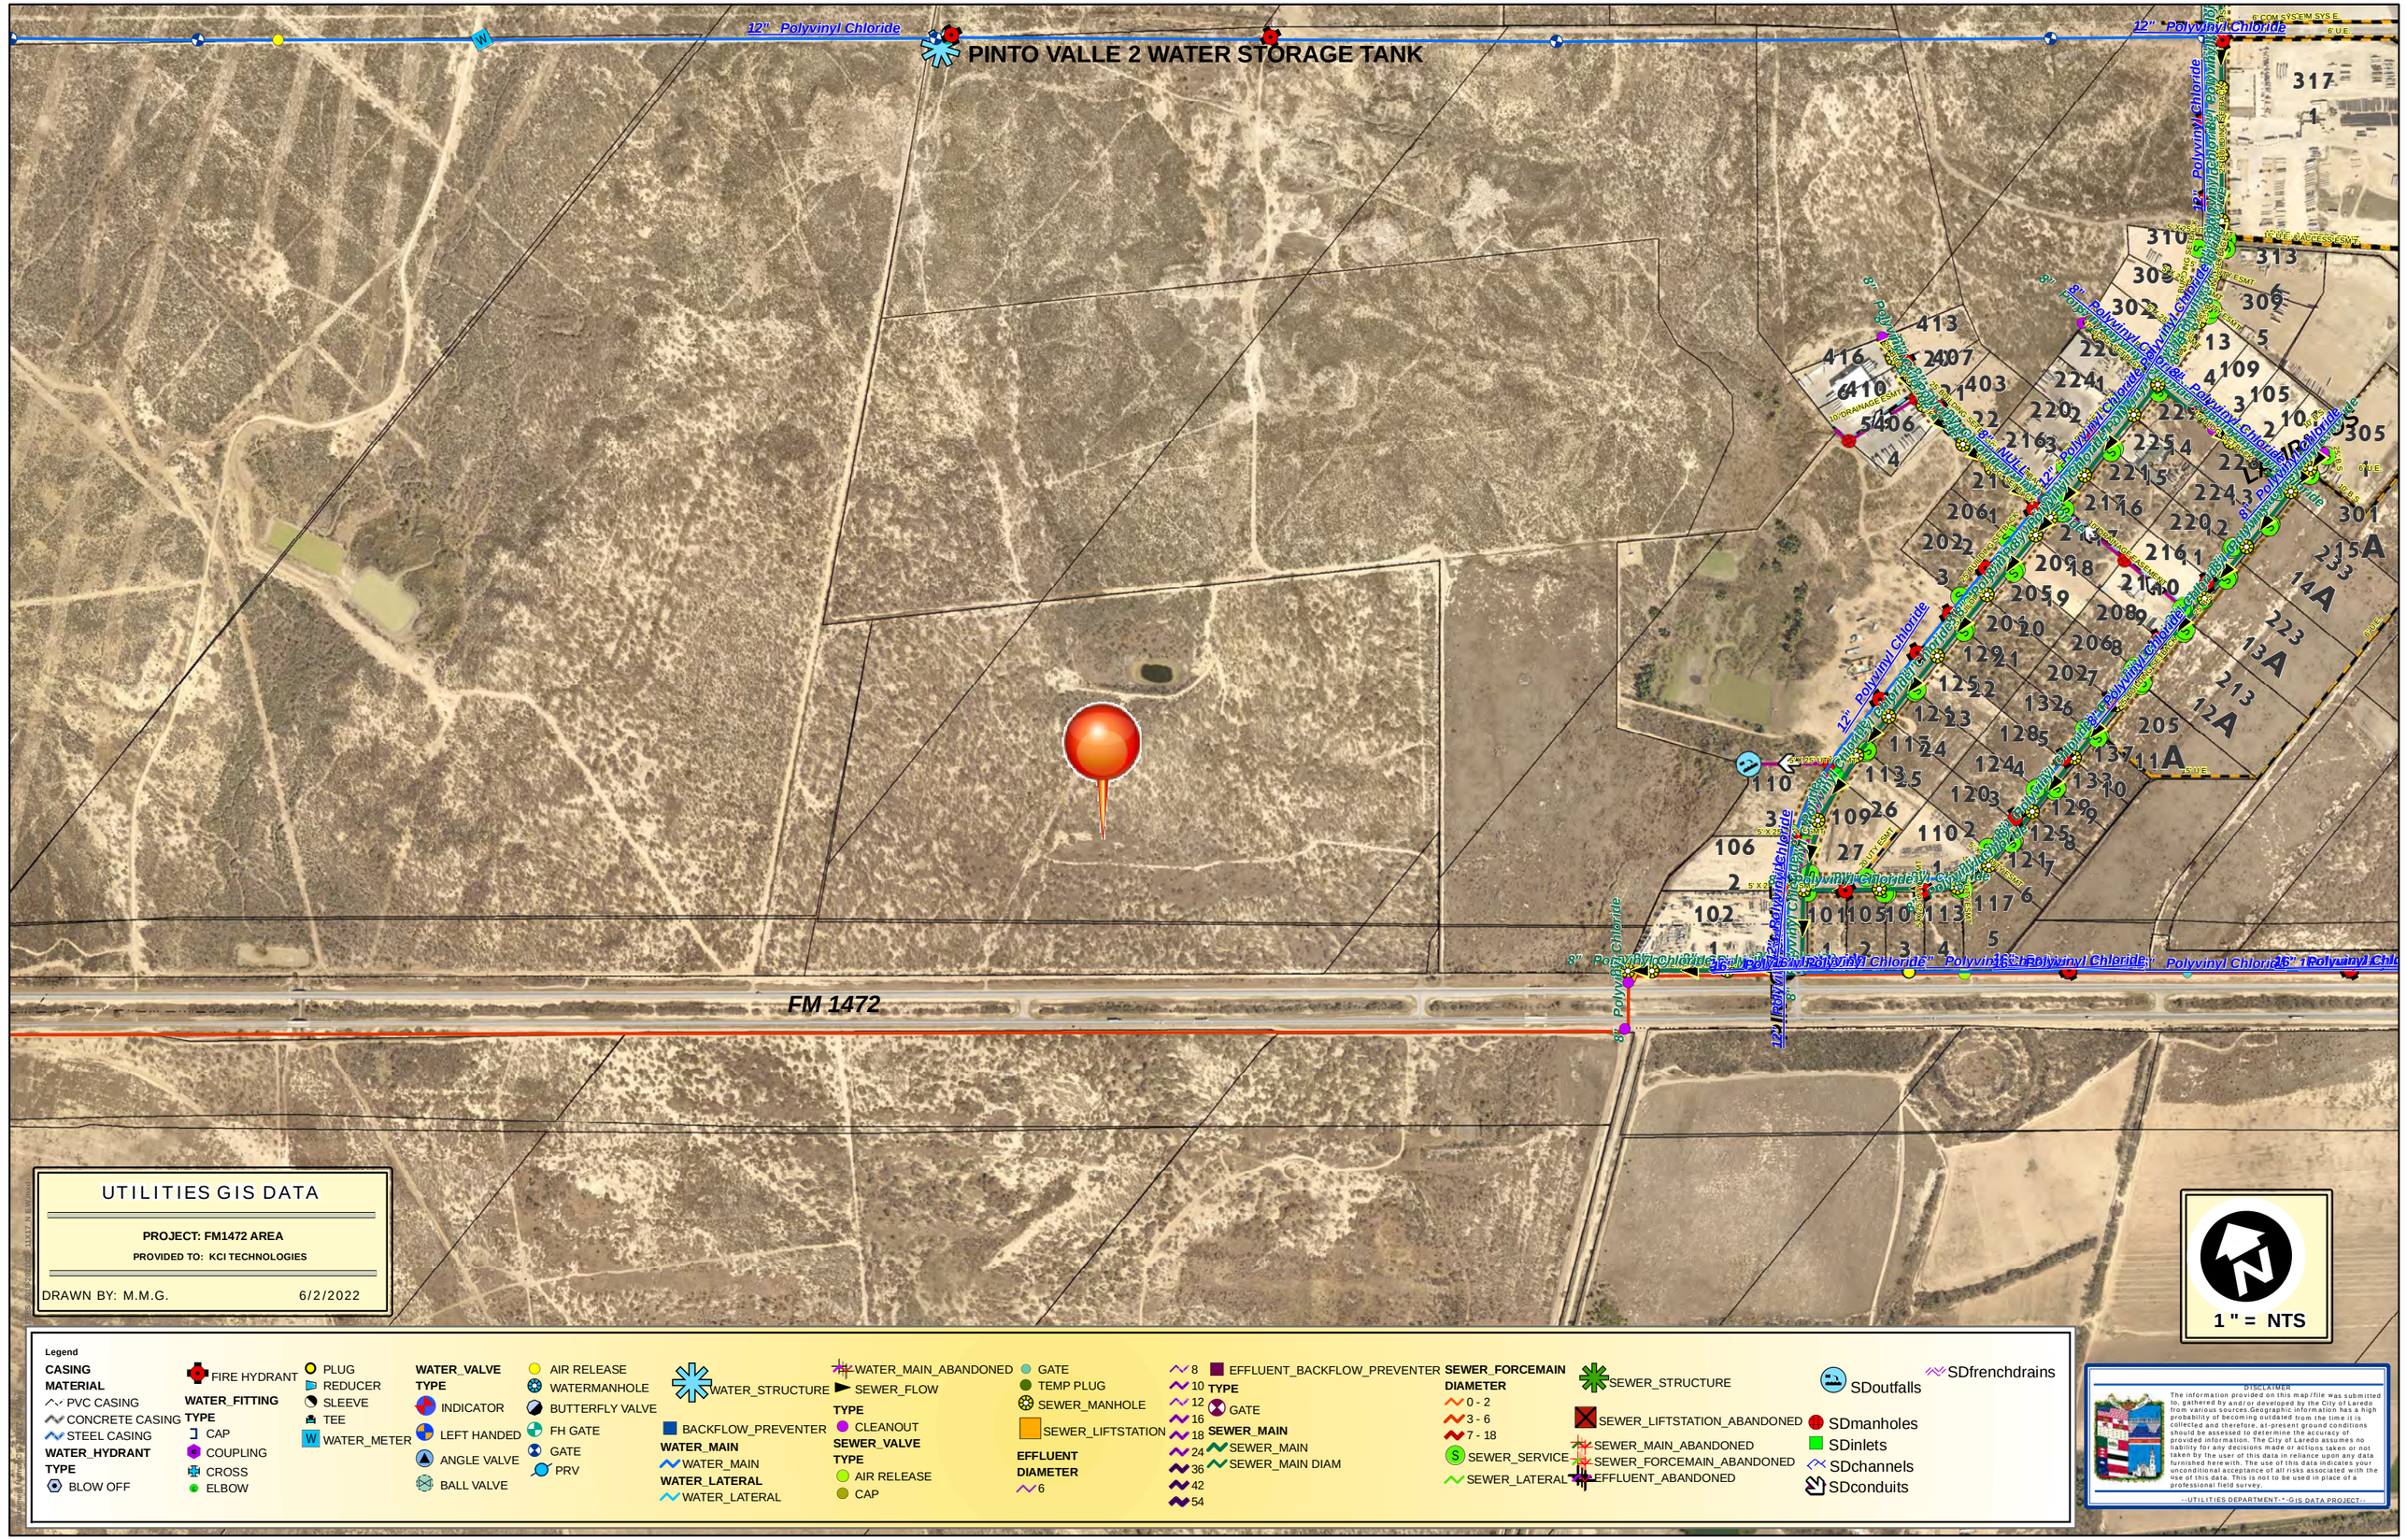
PINTO VALLE 2 WATER STORAGE TANK
12" Polyvinyl Chloride
FM 1472
UTILITIES GIS DATA
PROJECT: FM1472 AREA
PROVIDED TO: KCI TECHNOLOGIES
DRAWN BY: M.M.G.
6/2/2022
1 " = NTS
Legend
CASING MATERIAL
PVC CASING
CONCRETE CASING
STEEL CASING
WATER_HYDRANT TYPE
BLOW OFF
FIRE HYDRANT
WATER_FITTING TYPE
CAP
COUPLING
CROSS
ELBOW
PLUG
REDUCER
SLEEVE
TEE
WATER_METER
WATER_VALVE TYPE
INDICATOR
LEFT HANDED
ANGLE VALVE
BALL VALVE
AIR RELEASE
WATERMANHOLE
BUTTERFLY VALVE
FH GATE
GATE
PRV
WATER_STRUCTURE
BACKFLOW_PREVENTER
WATER_MAIN
WATER_MAIN
WATER_LATERAL
WATER_LATERAL
WATER_MAIN_ABANDONED
SEWER_FLOW
TYPE
CLEANOUT
SEWER_VALVE TYPE
AIR RELEASE
CAP
GATE
TEMP PLUG
SEWER_MANHOLE
SEWER_LIFTSTATION
EFFLUENT DIAMETER
6
8
10
12
16
18
24
36
42
54
EFFLUENT_BACKFLOW_PREVENTER
TYPE
GATE
SEWER_MAIN
SEWER_MAIN
SEWER_MAIN DIAM
SEWER_FORCEMAIN DIAMETER
0 - 2
3 - 6
7 - 18
SEWER_SERVICE
SEWER_LATERAL
SEWER_STRUCTURE
SEWER_LIFTSTATION_ABANDONED
SEWER_MAIN_ABANDONED
SEWER_FORCEMAIN_ABANDONED
EFFLUENT_ABANDONED
SDoutfalls
SDmanholes
SDinlets
SDchannels
SDconduits
SDfrenchdrains
DISCLAIMER
The information provided on this map/file was submitted to, gathered by and/or developed by the City of Laredo from various sources.Geographic information has a high probability of becoming outdated from the time it is collected and therefore, at-present ground conditions should be assessed to determine the accuracy of provided information. The City of Laredo assumes no liability for any decisions made or actions taken or not taken by the user of this data in reliance upon any data furnished herewith. The use of this data indicates your unconditional acceptance of all risks associated with the use of this data. This is not to be used in place of a professional field survey.
--UTILITIES DEPARTMENT--GIS DATA PROJECT--