


SITE SKETCH / SYSTEM DESIGN

HENDERSON COUNTY

Rugged Top Rd
Pin9681-25-7605
14.15 Acres



"This AOWE/PE submittal is pursuant to and meets the requirements of G.S. 130A-335(a2) and (a5)."

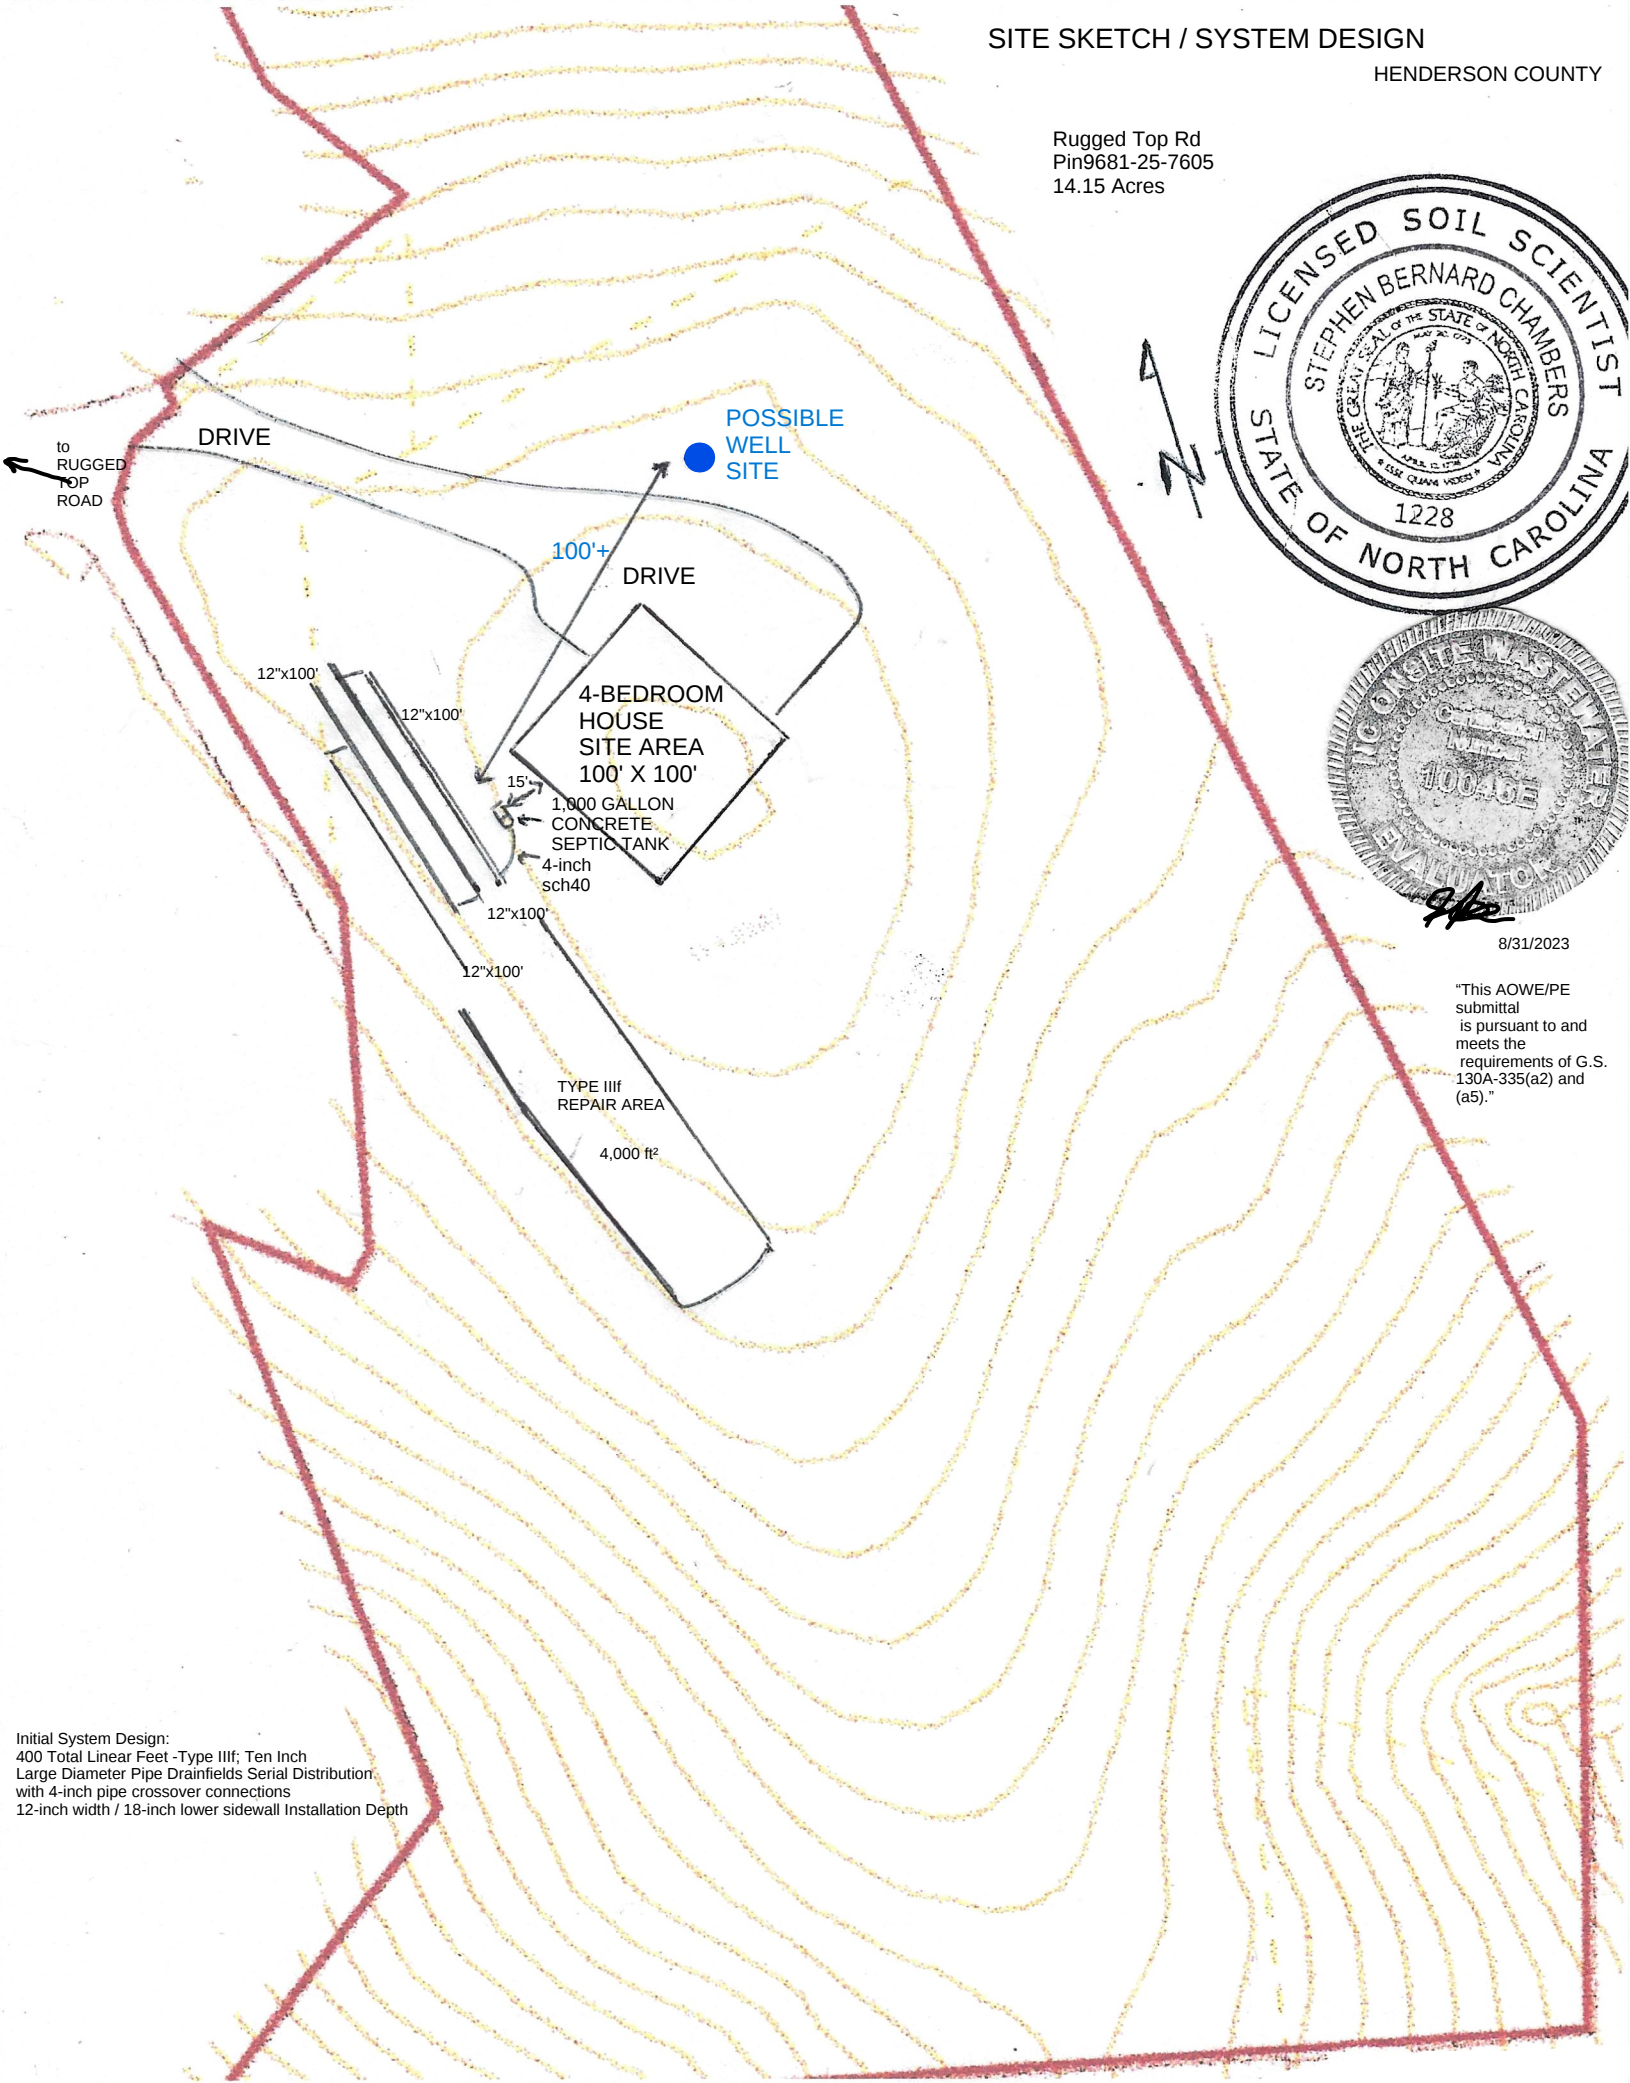

Initial System Design:
400 Total Linear Feet -Type IIIIf; Ten Inch Large Diameter Pipe Drainfields Serial Distribution with 4-inch pipe crossover connections 12-inch width / 18-inch lower sidewall Installation Depth

1 inch ~ 100 feet