



FIELD INSPECTION
REPORT FOR
ON-SITE SEWAGE
FACILITIES

Application No. 20020

Inspection:

Date 3-6-13

Time 8:00

By [Signature]

Permitted YES

Site Address 312 OAK CREEK CT

Property Owner RAMEY KEITH

Installer TOMMY HOLMES Cert. # 0025151 Cert. Type IT Phone # 817-929-4401

Distance:	Water Wells	Streams, Ponds	Foundation Walls	Property Lines
Septic Tank	<u>80+</u> ft.	<u>/</u> ft.	<u>5</u> ft.	<u>/</u> ft.
Disposal Area	<u>100+</u> ft.	<u>/</u> ft.	<u>100</u> ft.	<u>/</u> ft.

Septic Tanks: No. Compartment 2 Liquid Capacity 1000 Clean Out(s) 1
Inlet Below Top of Tank 3 in. Outlet Below Top of Tank 6 in.


Sub-Surface System: Trench / Bed / LP Piping / Other LAUNCHING CHAMBERS
Pipe Type / Pipe Size / Grade +1"
Trench Width 3' Trench Depth 28-30" Linear Feet 180
Total Square Feet 900 Distance Between Trenches 4-5'
Aggregate Type & Size / Under Pipe / Over Pipe /

Aerobic Treatment Manufacturer / Model / Treatment / G.P.D.
Surface Coverage Area / Square Feet

Remarks:

DO NOT PARK, DRIVE OR CONSTRUCT OVER THE TANKS OR DISPOSAL AREA.

36-5' BIODIFFUSOR PANELS
TEXAS PRECAST TANKS

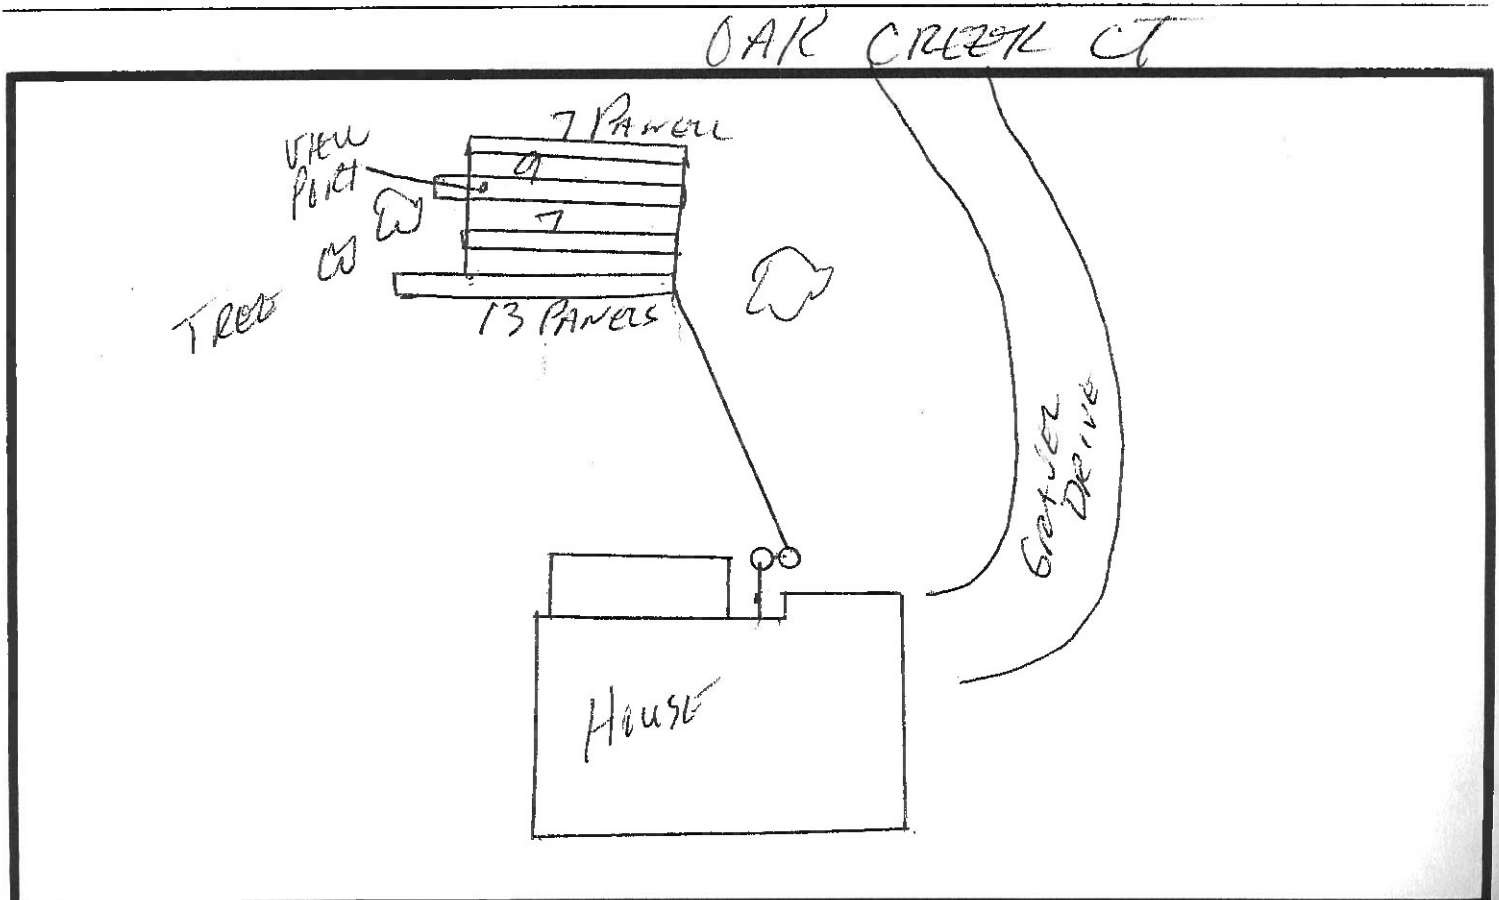



FIELD INSPECTION
REPORT FOR
ON-SITE SEWAGE
FACILITIES

Application No. 23787

Inspection:

Date 9-20-17

Time 9:10 am

By Mary Taylor 0032929

Permitted UFO

9:00

Site Address 312 OAK CREEK COURT (OFFICE) Est 10/18

Property Owner Ramey Keeth

Installer Craig Massey Cert. # 5694 Cert. Type TL Phone # 940-682-6695

Distance:

Septic Tank
Disposal Area

Water Wells

100' ft.
100' ft.

Streams, Ponds

100' ft.
100' ft.

Foundation Walls

5' ft.
14' ft.

Property Lines

100' ft.
100' ft.

Septic Tanks:

No. Compartment 2 Liquid Capacity 1000 Clean Out(s) 1
Inlet Below Top of Tank 3 in. Outlet Below Top of Tank 6 in.

Sub-Surface System:

Trench ☒ Bed ☐ LP Piping ☐ Other Leaching Chamber
Pipe Type ☐ Pipe Size ☐ Grade 2
Trench Width 32" Trench Depth 24" Linear Feet 60'
Total Square Feet 3008 Distance Between Trenches 5'
Aggregate Type & Size ☐ Under Pipe ☐ Over Pipe ☐

Aerobic Treatment

Manufacturer ☐ Model ☐ Treatment ☐ G.P.D.
Surface Coverage Area ☐ Square Feet

Remarks:

DO NOT PARK, DRIVE OR CONSTRUCT OVER THE TANKS OR DISPOSAL AREA.

Sealed with Ram neck

