

To: Eastern Cemetery Properties Address: _____

You are hereby issued a permit to install
a small sewage disposal system consisting of a septic tank and drainfield
and located at Sugar Run LOT # 18

This small sewage disposal system shall meet the following specifications:

1. Septic Tank
 - a. Shall be made of precast concrete and not less than 1000 gallon capacity. 400 Linear Feet of 10" GRAVELLESS PIPE
2. Soil-Absorption System
 - a. Shall consist of 4 distribution lines 4" in diameter.
 - b. Each distribution line shall be 100 100 100 100 feet in length
 - c. Each trench shall be 24 inch width with ZERO slope on trench bottom and ZERO slope on each distribution line.
 - d. No trench shall be more than 24 inches deep.
 - e. Total soil-absorption area in trench bottoms shall be 1200 sq. ft.
 - f. Filter material shall be gravel and not greater than 1/2 - 2 1/2 inches in diameter.
 - g. Filter material under each line shall be not less than 6 inches deep and not less than 2 inches over each distribution line.
 - h. Filter material shall be covered with _____ prior to backfilling.
 - i. Trenches shall be backfilled at least 6" above ground surface to provide for settling of backfill.
3. Other Small Sewage or Excreta Disposal Systems (Name the type system to be used, then use back of sheet to describe the details of the system.) IF 6' HOLE WATER AT TIME OF INSTALLATION, DIVERSION DIVERSION WILL BE NEEDED
4. Special Requirements
 - a. Small sewage and excreta disposal systems shall be located at least 10 ft. from any property line and a minimum of 20 ft. from any stream or roadside cut.
 - b. Septic tanks shall be located at least 10 ft. and excreta disposal systems a minimum of 20 ft. from building foundation.
 - c. Septic tanks shall be located a minimum of 50 ft. and soil-absorption systems and excreta disposal systems a minimum of 100 ft. from any ground water supply or cistern.
5. This permit is not transferable and automatically expires ¹²12 months after date of issue.
6. The applicant or his agent must notify this department, phone 822-5111 at least 72 hours before the system is ready for inspection.
7. All small sewage and excreta disposal systems must be inspected and approved prior to being covered with earth or otherwise put into service. Any applicable system or part thereof covered before being inspected shall be uncovered at the direction of the SANITARIAN.
8. This permit is NULL AND VOID when official inspection reveals conditions are different than those stipulated in this permit or if facts later become known that a health hazard would result by the installation of this system.

3-31-95
Date of Issue

J. H. Under
Name
Sanitarian
Title

Hampshire County Health Dept.
66 N. High Street Room #3
Hampshire, WV 26757
Phone: 304-822-5111

(Use reverse side of page for sketch of system)

Please draw a sketch of the property showing existing or proposed sewage disposal system. Indicate the location of the proposed sewage systems within 200 feet of well location, slope of site and lot dimensions. Locate animal pens, barns, yards or any other factors which can be a possible source of contamination for the water supply.



House



Soil Absorption Line



Trees



Water Supply



Dir. of Ground Slope



Septic Tank




Percolation Test Site



Property Line



Mobilehome

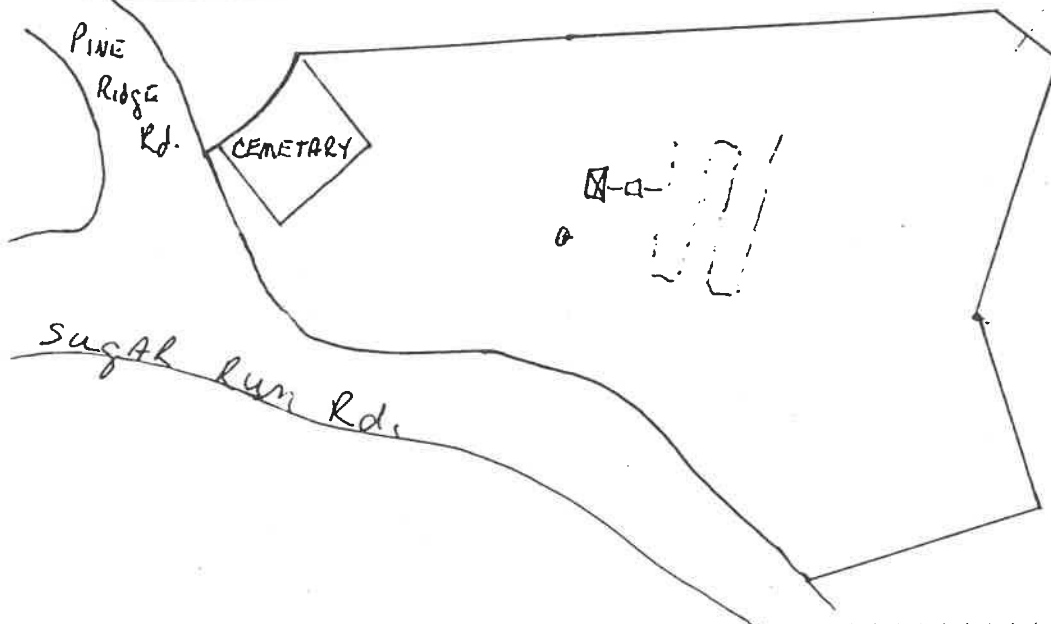

PART III SEWAGE DISPOSAL SYSTEM INFORMATION

☒ Install

☐ Modify

☒ Septic Tank

☒ Absorption Field

☐ Holding Tank

☐ Pit Privy

☐ Vault Privy

☐ Chemical/Composting Toilet

☐ Alternate System (attach detailed plans)

Other _____

DESCRIPTION OF PROPOSED SYSTEM:

Septic Tank: Capacity 1,000 gal.

Material concrete

Nearest Prop. Line 10' +

Absorption Field: 1,200 Sq. ft. with

4

lines and

100' long

Pipe ASTM No. 10" graveless

Nearest Property Line 10' +

Type of Water Supply well

Area Suitable for Absorption Field: all Sq. ft.

Six-foot hole free of water or solid rock?

☒ Yes

☐ No

PERCOLATION TEST:

TEST HOLE:

#1

#2

#3

#4

90 minutes

72 minutes

90 minutes

120 minutes

Total minutes 372, divided by 24 = 16 average time for water to fall one inch.

Test done on 3-13-95 (date) using approved procedures outlined in the Design Standards.

Signed:

Jerald L. Cain Sr.

Cain Construction 304-229-2110

Jerald L. Cain Sr.
Signature of Installer
RT 2, Box 477
Beverly Hills W.V.
25413

54-80-0153
Certification No.

3-13-95
Date