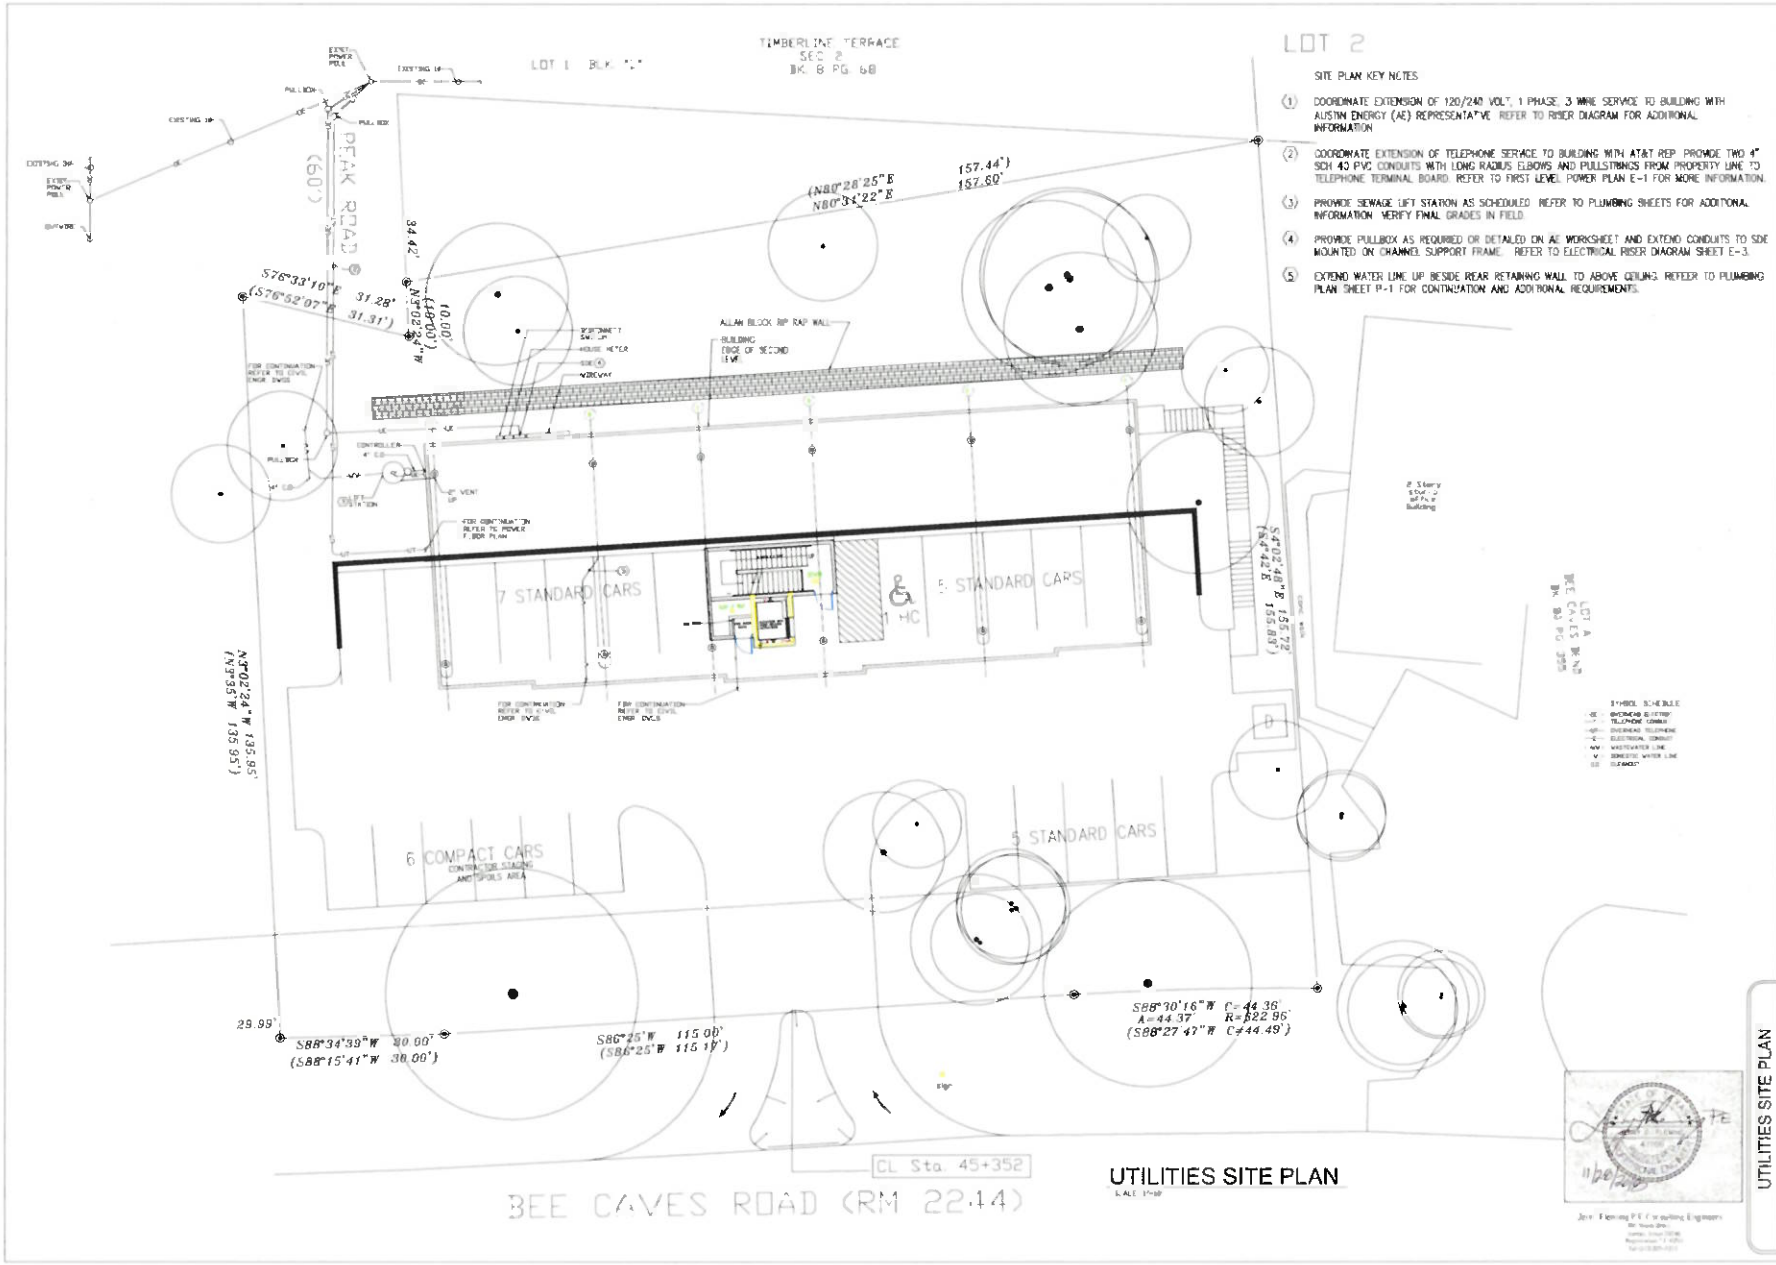

SITE PLAN KEY NOTES

1. COORDINATE EXTENSION OF 120/240 VOLT, 1 PHASE, 3 WIRE SERVICE TO BUILDING WITH AUSTIN ENERGY (AE) REPRESENTATIVE. REFER TO RISER DIAGRAM FOR ADDITIONAL INFORMATION.
2. COORDINATE EXTENSION OF TELEPHONE SERVICE TO BUILDING WITH AT&T REP. PROVIDE TWO 4" SCH 40 PVC CONDUITS WITH LONG RADIUS ELBOWS AND PULLSTRINGS FROM PROPERTY LINE TO TELEPHONE TERMINAL BOARD. REFER TO FIRST LEVEL POWER PLAN E-1 FOR MORE INFORMATION.
3. PROVIDE SEWAGE LIFT STATION AS SCHEDULED. REFER TO PLUMBING SHEETS FOR ADDITIONAL INFORMATION. VERIFY FINAL GRADES IN FIELD.
4. PROVIDE PULLBOX AS REQUIRED OR DETAILED ON AE WORKSHEET AND EXTEND CONDUITS TO SIDE MOUNTED ON CHANNEL SUPPORT FRAME. REFER TO ELECTRICAL RISER DIAGRAM SHEET E-3.
5. EXTEND WATER LINE UP BESIDE REAR RETAINING WALL TO ABOVE CEILING. REFEER TO PLUMBING PLAN SHEET P-1 FOR CONTINUATION AND ADDITIONAL REQUIREMENTS.

UTILITIES SITE PLAN

SCALE: 1"=10'

Jim Fleming P.E. Consulting Engineers

Flower & Associates

ROLLINGWOOD OFFICE
3012 BEE CAVES ROAD
AUSTIN TX. 78746

UTILITIES SITE PLAN

DATE ISSUED
10/10/04

REVISIONS

NO.	DATE	BY

DRAWN BY CHECKED

FILE NAME

SHEET NO.

MEP-1